

Chick-fil-A
5200 Buffington Rd.
Atlanta Georgia,
30349-2998

Revisions:	Mark	Date	By
	▲	5/11/07	owner changes

Mark	Date	By
▲		

Mark	Date	By
▲		

SEAL

SEAL


BENNOR ENGINEERING, LLC
3000 Longford Road
Building 2400
Norcross, GA 30071
(770) 729-0490 fax
rbennor@bennoreng.com

STORE
Las Colinas FSU
5350 N.
MacArthur
Irving, TX 75038

SHEET TITLE
PLUMBING
ISO PLANS

DWG EDITION 01.0
Job No. : 7024
Store : 0601
Date : 2/23/07
Drawn By : JAL
Checked By : RDB

Sheet
P-2.1

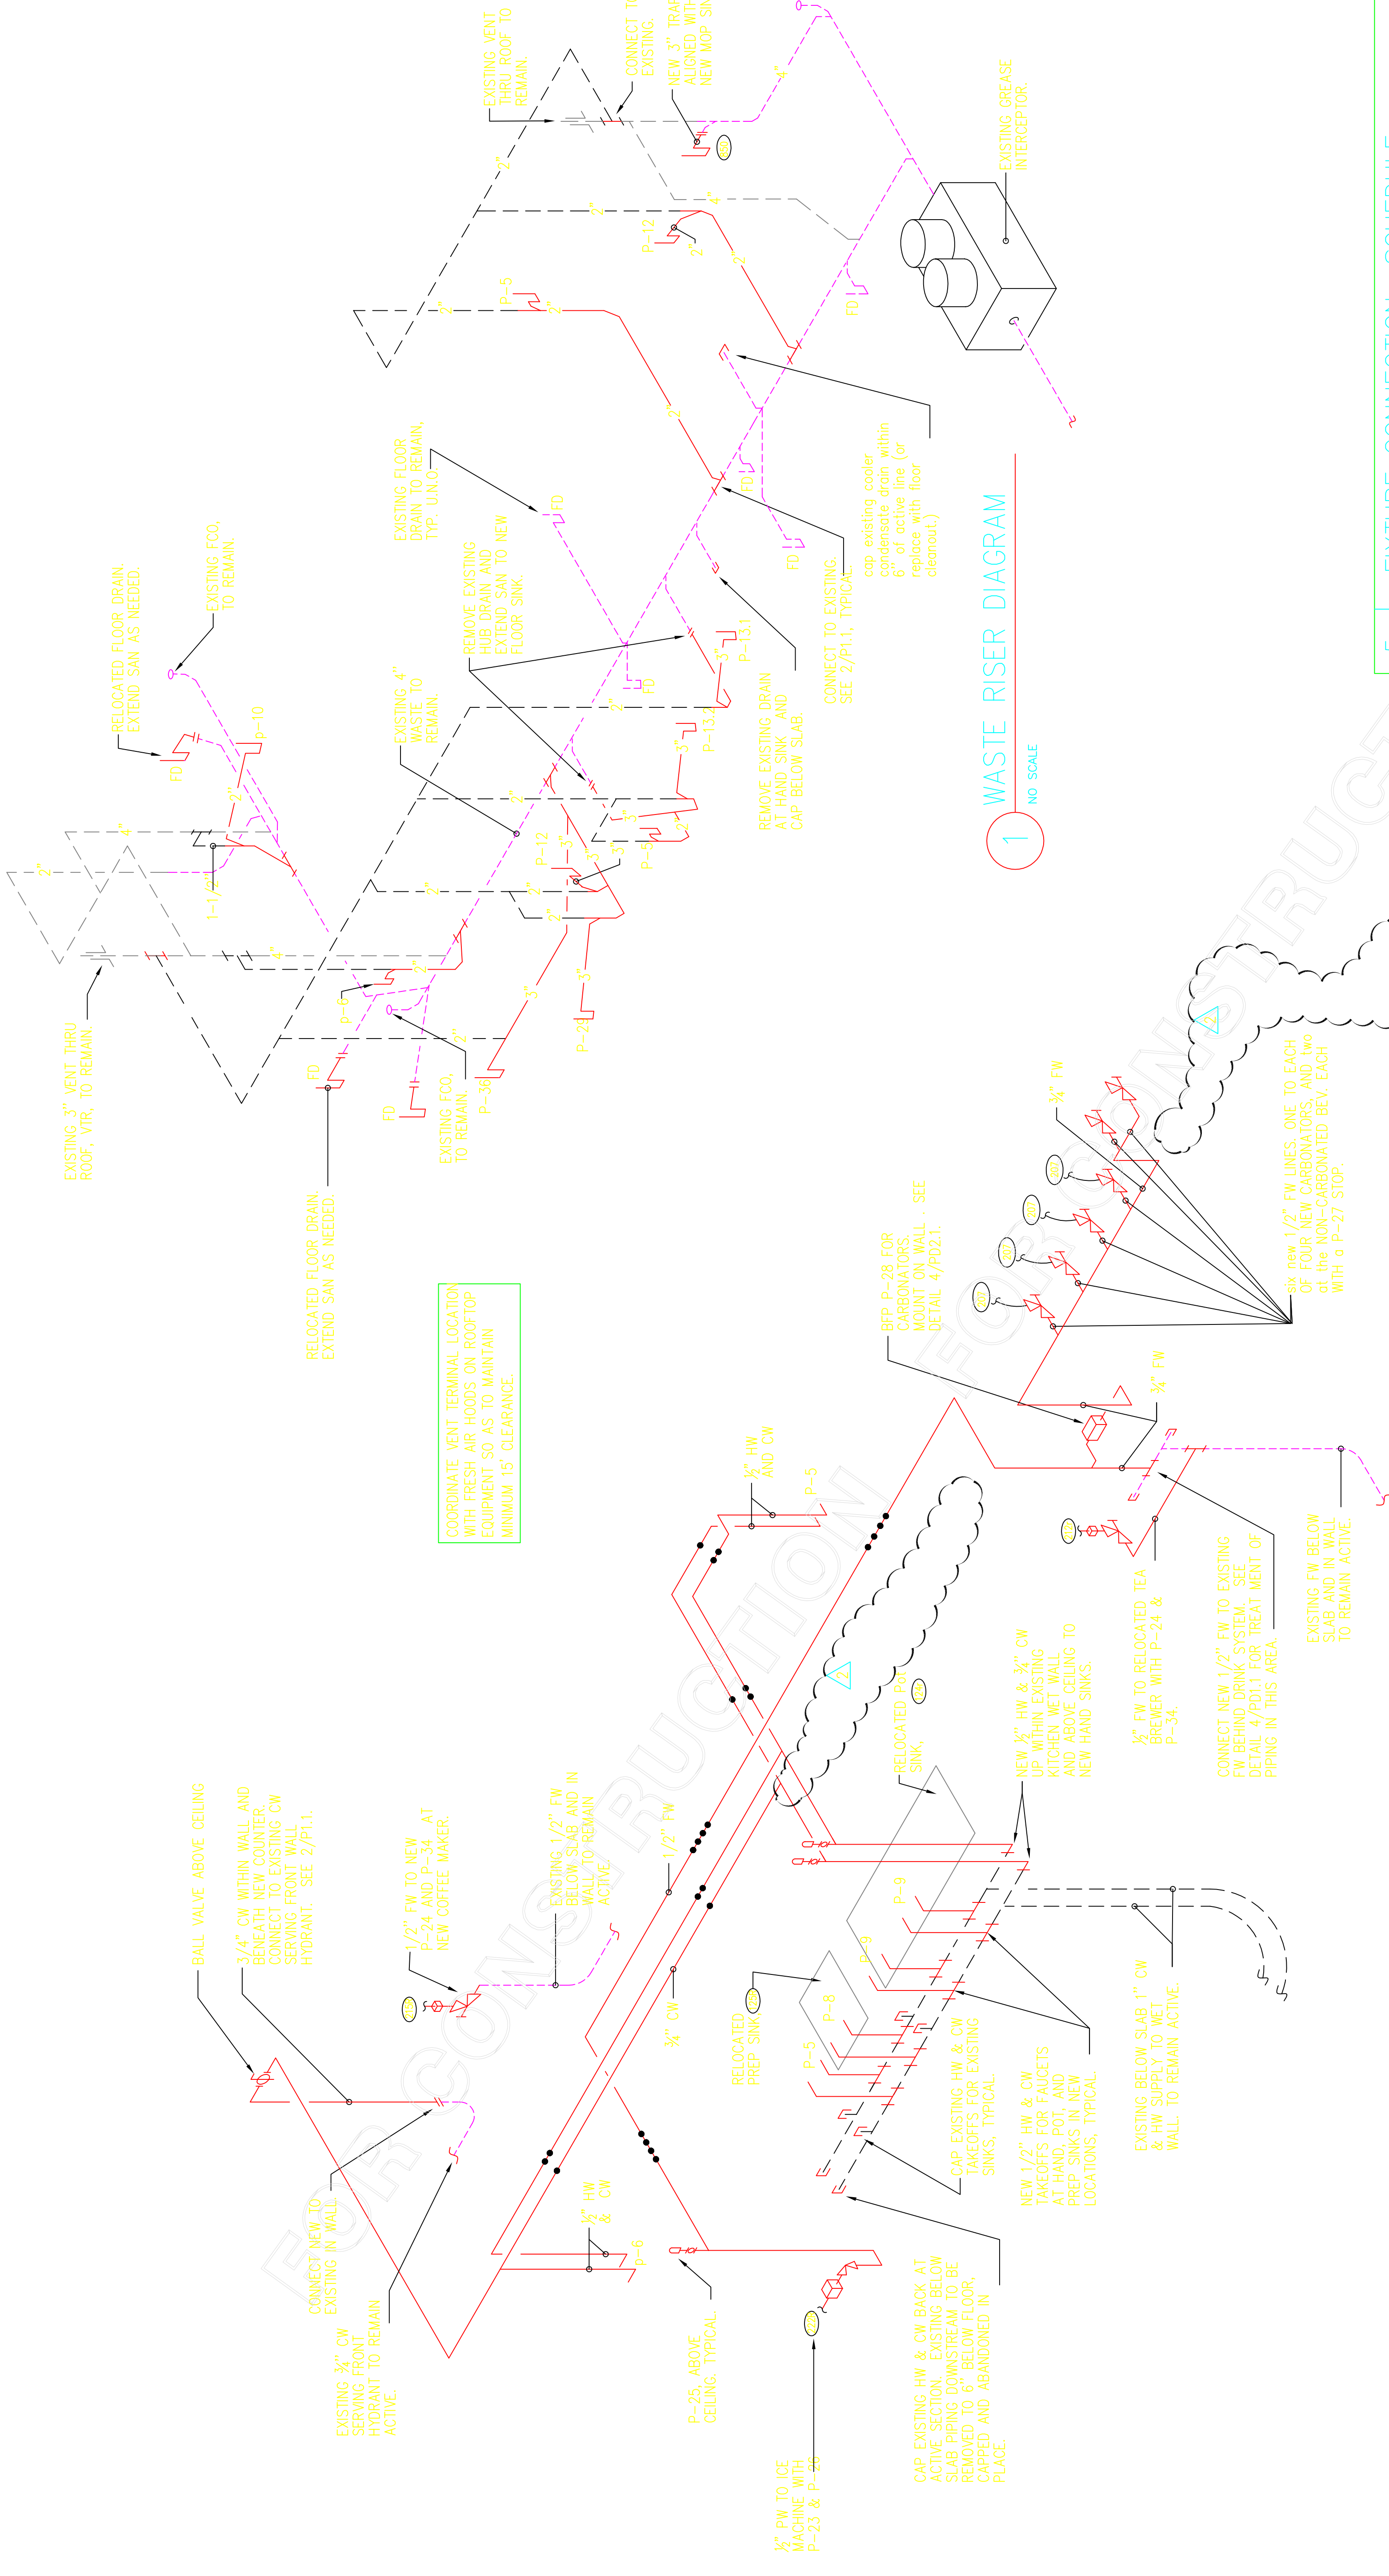

2 WATER RISER DIAGRAM - NO SCALE

PIPING LEGEND

- COLD WATER (CW)
- HOT WATER (HW)
- FILTERED WATER (FW)
- VENT
- SANITARY
- EXISTING SANITARY
- EXISTING SANITARY

4. KITCHEN EQUIPMENT SCHEDULE

TAG	DESCRIPTION	NOTES	F.W.	C.W.	H.W.	WASTE	ROUGH-IN
124F	relocated POT SINK (NEW FAUCETS P-9)	SEE SHEET 1/1-2.1	X	1/2"	1/2"		
125B	RELOCATED PREP SINK (NEW FAUCET P-8)	SEE SHEET 1/1-2.1	X	1/2"	1/2"		
207	NEW CARBONATOR	SEE SHEET 1/1-2.1	X	X	X		
208R	relocated co2 tank	P-231 100" AFT	X	X	X		
212F	relocated tea brewer	see note on p-11	X	X	X		
215R	RELOCATED COFFEE MAKER	P-24 & P-34 48" AFE	X	X	X		
221R	RELOCATED ICE BIN	P-24 & P-34 48" AFE	X	X	X		
222R	RELOCATED ICE MAKER	INDIRECT	X	X	X		
222R	new mop sink	P-23 80" & 104" AFE	X	X	X		

NOTES:
 1. PROVIDE NEW WCOURE 175 SUPPLIES WITH WHEEL HANDLE STOPS.
 2. INDIRECT WASTE TO NEW FLOOR SINK.
 3. SEE DETAIL 1/PD1.1
 4. SEE DETAIL 3/PD1.1.
 5. EXISTING FAUCET TO REMAIN. REMOVE AND RE-PIPE AS NEEDED TO ACCOMMODATE INSTALLATION OF NEW BACKSPASH PANELS. INSTALLATION OF BACKSPASH PANELS BY GENERAL CONTRACTOR.
 6. SEE DETAIL 2/PD1.1 FOR DRAIN CONNECTION.

5. FIXTURE CONNECTION SCHEDULE

MARK	FIXTURE	F.W.	C.W.	H.W.	WASTE
P-4	RESTROOM LAVATORY - WALL HUNG	X	1/2"	1/2"	1-1/2"
P-5	KITCHEN HAND SINK - WALL HUNG	X	1/2"	1/2"	1-1/2"
P-6	KITCHEN HAND SINK - countertop	X	1/2"	1/2"	1-1/2"
P-8	NEW FAUCET AT RELOCATED PREP SINK	X	1/2"	1/2"	EXISTING
P-9	NEW FAUCET AT RELOCATED POT SINK	X	1/2"	1/2"	EXISTING
P-10	FLOOR DRAIN	X	X	X	SEE PLAN
P-12	FUNNEL DRAIN	X	X	X	SEE 2/P1.1
P-13.1	FLOOR SINK (12 X 12 TOP)	X	X	X	3"
P-13.2	FLOOR SINK (8 X 8 TOP)	X	X	X	3"
P-14	CLEANOUT INSIDE BUILDING	X	X	X	SEE 1/P2.1
P-15	CLEANOUT OUTSIDE BUILDING	X	X	X	SEE 1/P2.1
P-23	UTILITY CONNECTION (ICE MAKER)	1/2"	1/2"	1/2"	X
P-24	UTILITY CONNECTION (COFFEE & TEA BREWERS)	1/2"	1/2"	1/2"	X
P-25	SHOCK ABSORBER	1/2"	1/2"	1/2"	X
P-26	ICE MACHINE BACKFLOW PREVENTER	1/2"	1/2"	1/2"	X
P-27	UTILITY CONNECTION (CARBONATORS)	1/2"	1/2"	1/2"	X
P-28	CARBONATOR BACKFLOW PREVENTER	3/4"	X	X	X
P-29	ICE MACHINE FLOOR SINK	X	X	X	3"
P-34	DISPENSER BACKFLOW PREVENTER	1/2"	X	X	X
P-36	INDIRECT WASTE RECEIVER	X	X	X	3"

NOTES:
 1. REFER TO FOOD SERVICE DRAWINGS FOR KITCHEN EQUIPMENT INSTALLATION AND HOOK-UP RESPONSIBILITIES.
 2. FIELD VERIFY SIZES LISTED ON EXISTING EQUIPMENT PRIOR TO ORDERING MATERIALS.